



WIDOK Z GÓRY

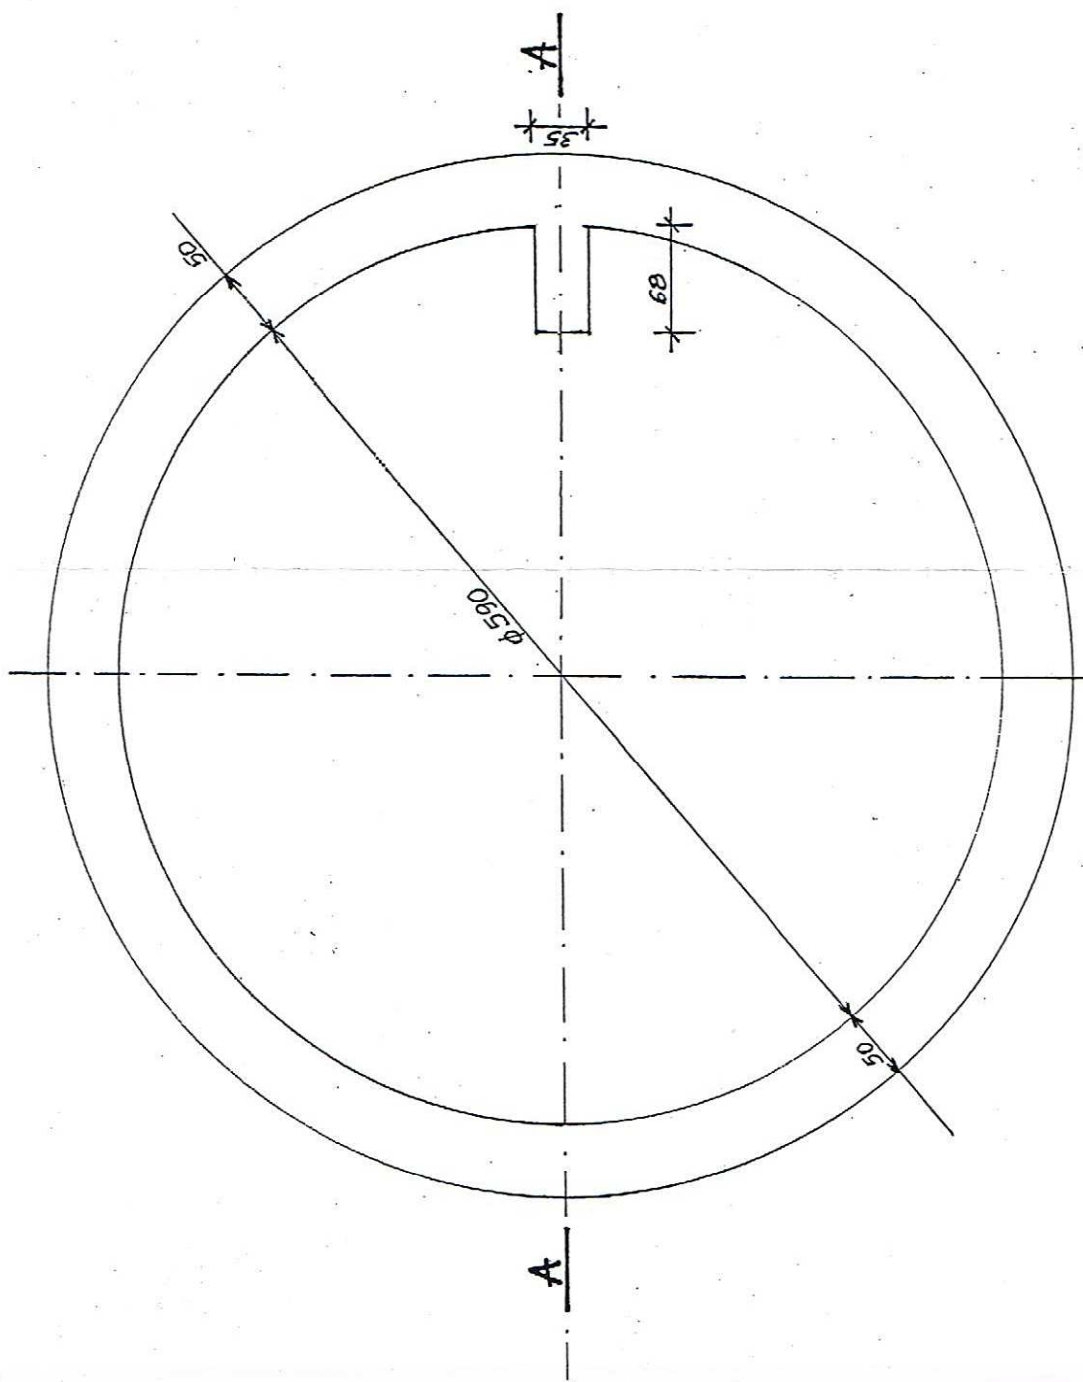

A-A

izolacja asfaltowa-zyniczna (na maziu)
 płyta betonowa zbrojona z bet. C20/25 - 130 cm
 podkład betonowy z bet. C7,5/10 - 10 cm
 posypka piaskowa - 20 cm

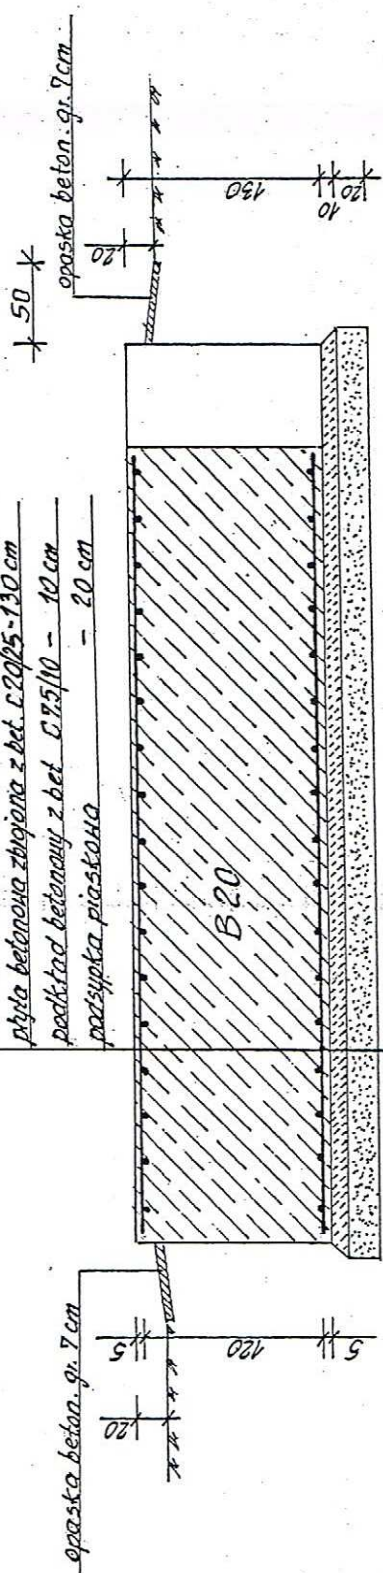

065

610

Ni prišta	materijal	φ	L	ilošt. pištolj	Σ L	masa jedn.	masa eksplm	Umagi
1	stal 34 G5	10	2.10	6	12.6	0.617	7.77	
2	stal 34 G5	10	3.25	6	19.5	0.617	12.03	
3	stal 34 G5	10	3.95	8	31.6	0.617	19.50	
4	stal 34 G5	10	4.50	8	36.0	0.617	22.21	
5	stal 34 G5	10	4.95	8	39.6	0.617	24.43	
6	stal 34 G5	10	5.30	8	42.4	0.617	26.16	
7	stal 34 G5	10	5.50	8	44.0	0.617	27.15	
8	stal 34 G5	10	5.65	8	45.2	0.617	27.89	
9	stal 34 G5	10	5.75	8	46.0	0.617	28.38	
10	stal 34 G5	10	5.80	2	10.0	0.617	6.17	
11	stal 34 G5	10	5.80	2	11.6	0.617	7.16	
12	stal 34 G5	10	1.40	4	5.6	0.617	3.46	
13	stal 34 G5	10	0.90	4	3.6	0.617	2.22	
					OROKEM	347.7	214.53	

Objekt:

Obiekt: Rozbudowa stacji podosiadkowej

Adres: Justynów - dz. 766, 765, 632/4, gm. Andrieşpol

Investor: Gmina Andieszów ul. Rokicińska 126 : 95-020 Andieszów

प्रत्यक्षः

.. Fundament pod zbiornik wody uzdatnionej

projektant:	skala:
	1:50

Date:

Mr 145:

6